

SIAMP

Monaco



BATTICCHASSE 535 M

Available 2007 September

Structure

Designed for attachment to the floor (2 points) and wall (6 points), allows the installation of a suspended toilet bowl secured to a supporting wall.

Made of steel tubes (30 x 30 x 1.5 mm) connected by electro-welding and coated with epoxy paint for corrosion protection.

Feet and adjustments

The feet consist of a large bichromated steel plate (100 x 30 x 8 mm) and two electro-welded bichromated steel tubes (25 x 25 x 2 mm).

They slide inside the structure for adjusting the frame height by 100 mm.

Attachments

The feet are attached to the structure by 2 setscrews allowing adjustment to within the millimeter by simple tightening.

Attachment to the floor is by eight plugs and screws of top quality.

Attachment of the bowl is by two 12 mm threaded rods and 2 wall brackets made integral with the structure

Cistern

The cistern is of HDPE with a maximum capacity of 6 liters.

Each cistern is tested individually before leaving our workshop.

Cistern equipment

Consisting of a dual flush mechanism and a silent float valve, both derived from the SIAMP standard range.

These products are NF and have, therefore, gone through the 200,000 manoeuvres test. The equipment was chosen by the most famous ceramic producers in the world for their own equipment.

Cistern water connection

Connection is directly inside the cistern to prevent any risk of leakage on the outside.

The supply can use any type of pipe (copper, reticulated, PVC, flexible, etc.), and the shut off valve has a bicone attachment.

Cistern supply

The bend is of HDPE to guarantee strength.

Tightness is provided by two O-rings on the outlet from the cistern and on the supply sleeve, on the bend side by a lip seal and on the bowl side by a multi-lip seal.

Bowl drain

The drain kit consists of a sleeve and a bent pipe made from HDPE.

The tightness between the pipe and the sleeve and the sleeve and the bowl is made by EPDM seals that are easily replaced if necessary. The attachment of the pipe to the frame is simplified by a clip-on collar.

NB: As an option, a straight drain kit is available


Maintenance

Depending on the hardness of the network water, it may be necessary to clean or change the membrane seals of the cistern equipment.


The control plate is used as an access trap and the cistern equipment is directly accessible and easy to remove from the cistern.

Control Panels

Dual flush

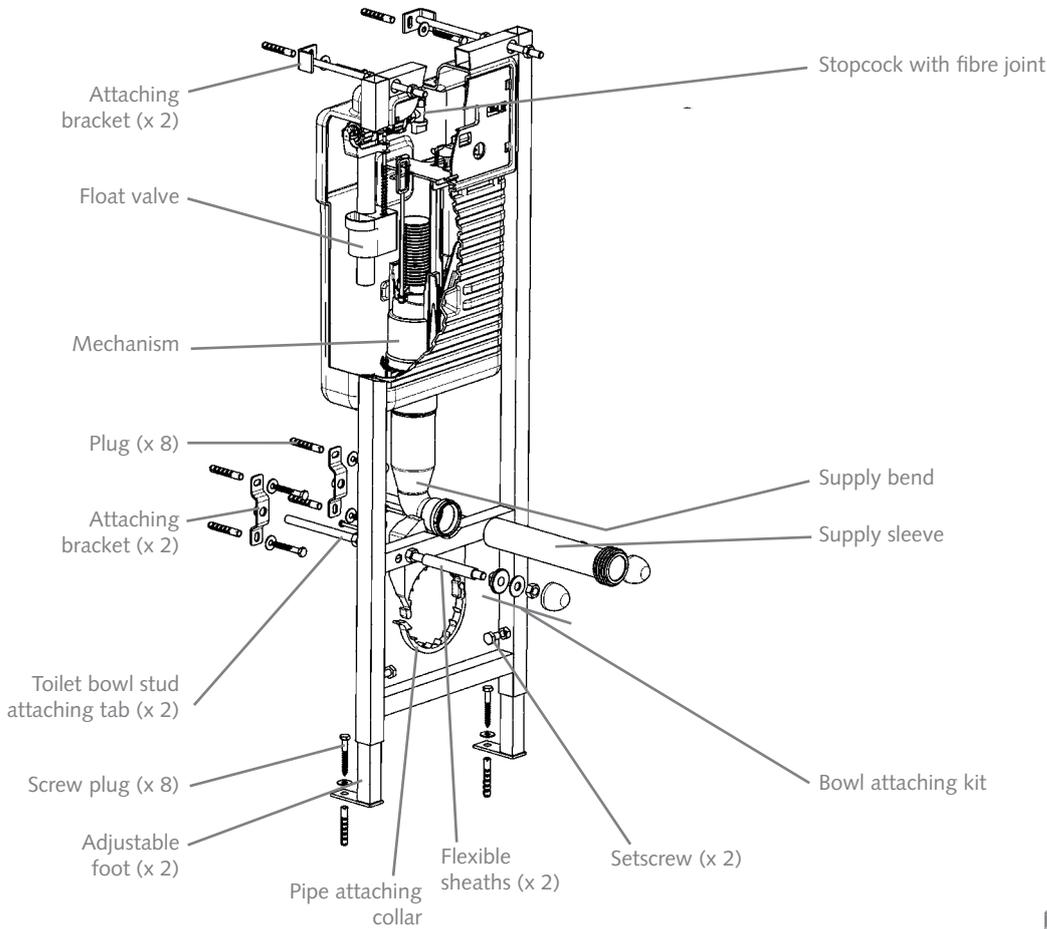

Type of installation



Attached to a supporting wall

